


LATERALS SHALL NOT
BE LOCATED IN
DRIVEWAYS OR SIDEWALKS.

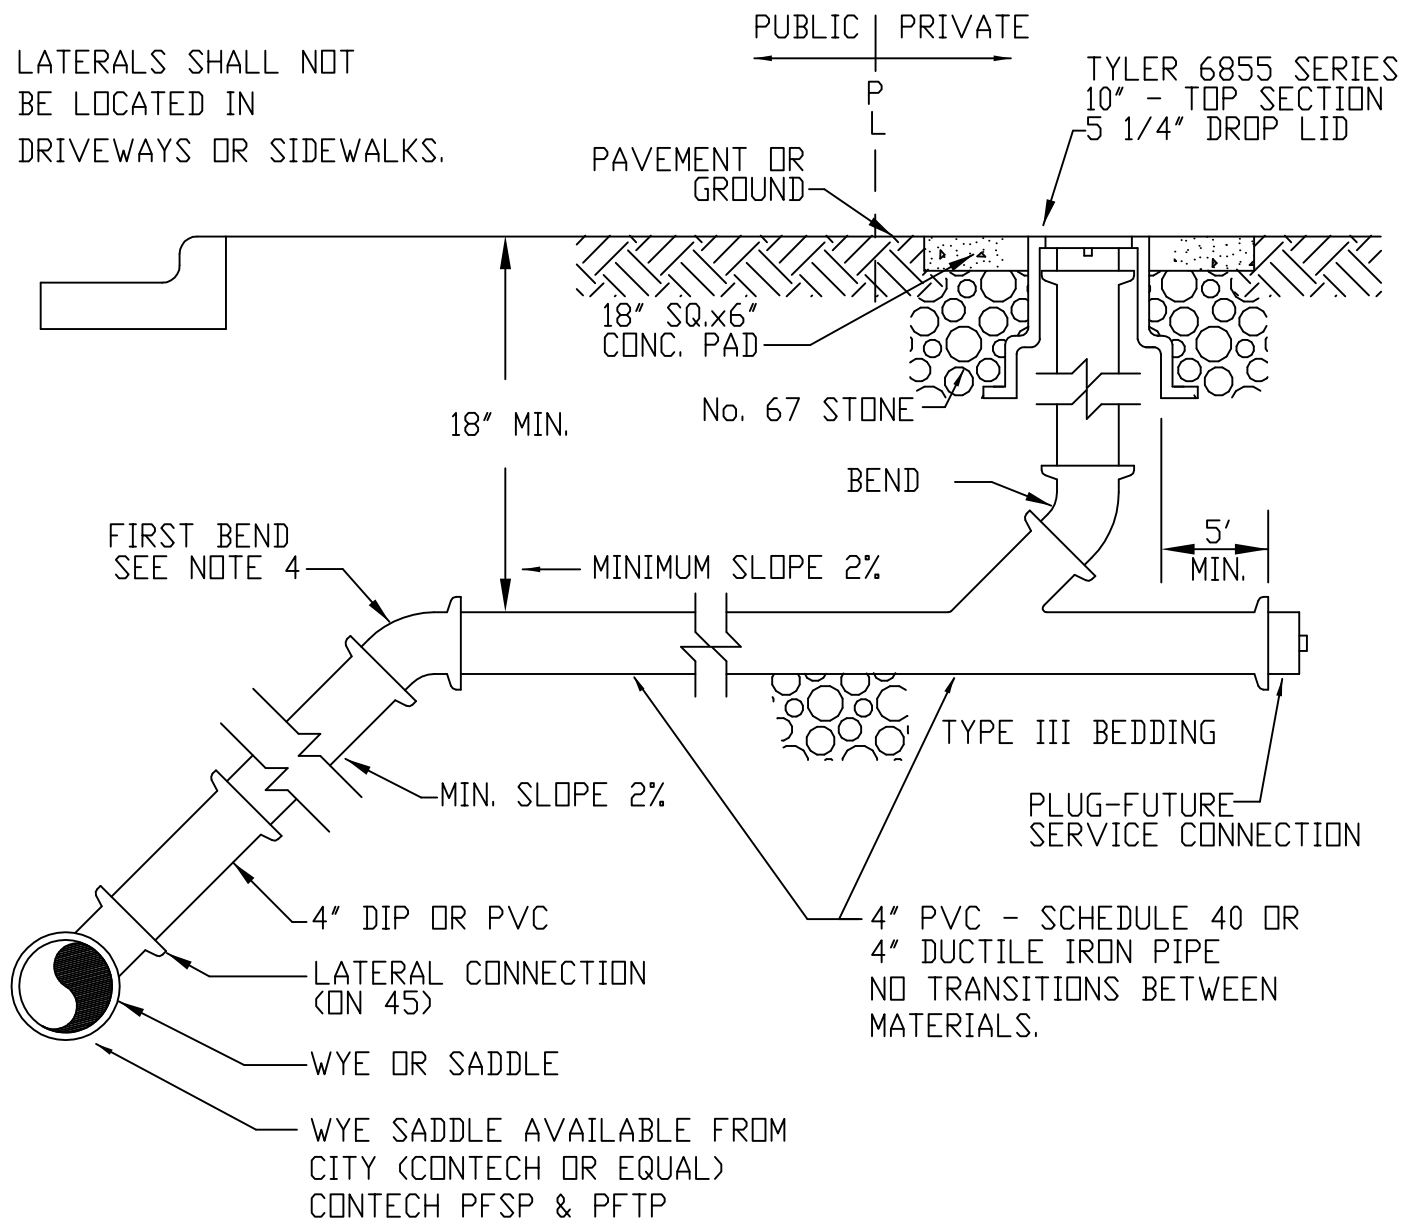

NOTES:

1. THE FULL LENGTH OF THE SERVICE DITCH SHALL BE COMPACTED IN 6" LAYERS WITH MECHANICAL TAMP, TO 95% STANDARD PROCTOR.
2. THE CITY SHALL MAKE TAPS ON EXISTING LINES
3. BENDS 1/16, 1/8, 1/4 AS REQUIRED.
4. FIRST BEND SHALL OCCUR BEHIND BACK OF CURB UNLESS SPECIFICALLY APPROVED BY THE UTILITIES ENGINEERING MANAGER.
5. ALL LATERALS 60' OR LONGER SHALL BE 6".
6. NO MATERIAL TRANSITIONS (LATERAL MUST BE ALL PVC OR ALL DIP)
7. WYES ONLY, NO TEES. SADDLES MAY ONLY BE USED ON EXISTING SEWER LINES.

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: OCTOBER 17, 2006

SEWER SYSTEMS
TAP & STUB-OUT

SCALE: NOT TO SCALE

STANDARD

SS-5